

CERTIFICATE OF ANALYSIS

Generic Name	Gentamicin Injection IP 80 mg/2ml		
Brand Name	GENTACAN	Product Code	GT
Batch No.	GTA25005	Batch Size	352 Liters
Mfg. Date	DEC.2025	Exp. Date	NOV.2028
Date of Sampling	06/01/2026	Completed Date	14/01/2026
A. R. No.	RLS/FP/260008	Specification No.	FPS008-02

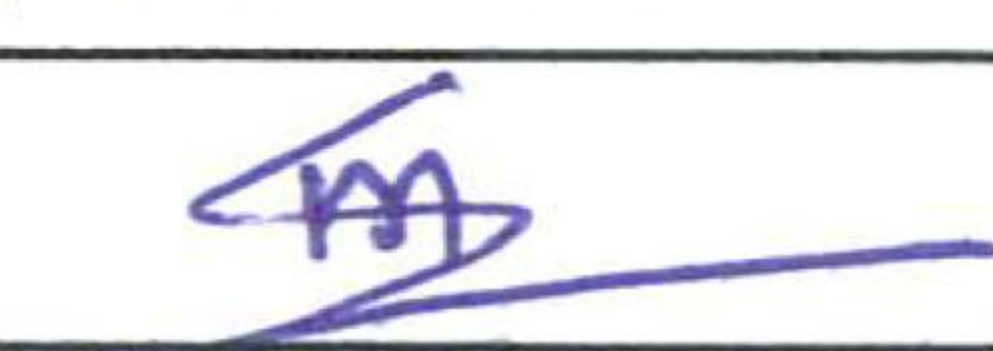
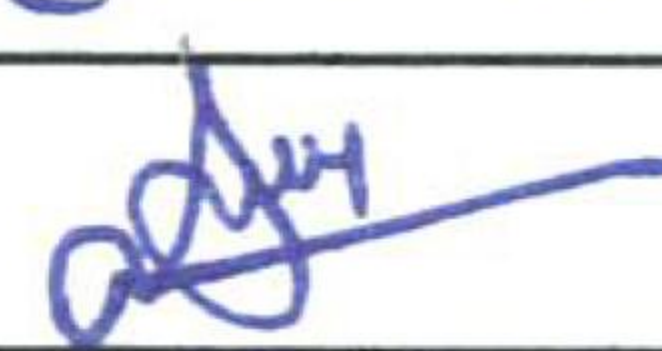
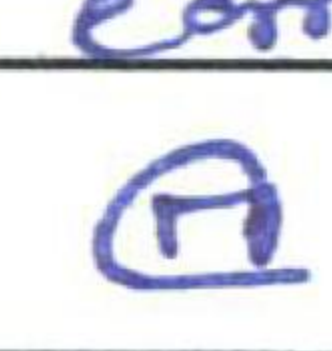
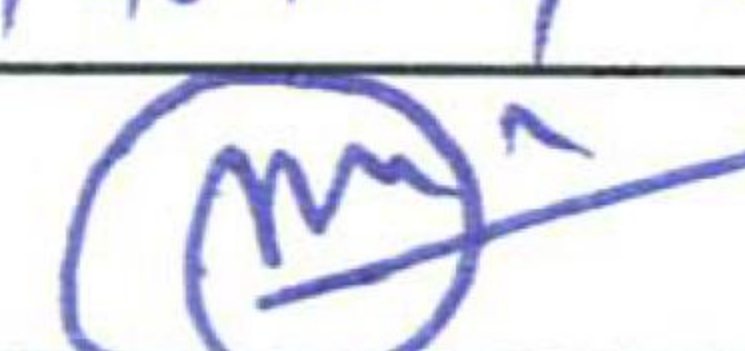
Sr. No.	Tests	Method	Specification	Results
1	Description	IP/ IH	A clear, colourless to pale-yellow solution with a faint odour filled in USP type I glass container.	A clear colourless Solution with a faint odour filled in USP type I, 2ml clear ampoule with blue dot.
2	Identification			
	Identification A	IP	The three principal spot in the chromatogram obtained with the test solution correspond to those in the chromatogram obtained with the reference solution.	Complies
	Identification B	IP	In the test for composition of gentamicin sulphate, the four principal peaks in the chromatogram obtained with the test solution correspond to the four peaks in the chromatogram obtained with the reference solution.	Complies
3	pH	IP	NLT 3.0 and NMT 5.0	3.92
4	Extractable volume	IP	NLT nominal volume in ml	2.0 ml
5	Particulate Matter			
	A Visual inspection	IP	Clear and practically free from particles when observed by visual inspection by unaided eyes.	Complies
	B Particle size $\geq 10 \mu\text{m}$	IH	NMT 6000 particles per container.	81.33
Particle size $\geq 25 \mu\text{m}$	NMT 600 particles per container.		3.60	

CERTIFICATE OF ANALYSIS

Generic Name	Gentamicin Injection IP 80 mg/2ml		
Brand Name	GENTACAN	Product Code	GT
Batch No.	GTA25005	Batch Size	352 Liters
Mfg. Date	DEC.2025	Exp. Date	NOV.2028
Date of Sampling	06/01/2026	Completed Date	14/01/2026
A. R. No.	RLS/FP/260008	Specification No.	FPS008-02

Sr. No.	Tests	Method	Specification	Results
6	Composition of gentamicin sulphate	IP	The proportions are within the following limits.	
			C ₁ is between 25.0% and 50.0%	27.7%
			C _{1a} is between 10.0% and 35.0%	26.3%
			The sum of the contents of gentamicin C _{2a} and gentamicin C ₂ is between 25.0 % to 55.0%	46.0%
7	Assay (Each 1 ml of solution contains 40 mg Gentamicin)	IP	NLT 95.0% and NMT 110.0% of the gentamicin	102.7% (41.08mg)
8	BET	IP	NMT 1.67 EU/ mg of gentamicin	Less than 0.82 EU/mg
9	Sterility	IH	Should be sterile	Sterile
Additional tests				
10	Methyl paraben content	IH	NLT 90.0% and NMT 110.0%	99.9%
	Propyl paraben content	IH	NLT 90.0% and NMT 110.0%	98.8%

Remarks: The product complies as per IP and In-house specification.

	Prepared by	Reviewed by	Approved by	Authorized by
Department	Quality Control	Quality Control	Quality Control	Quality Assurance
Name	Manoj Jadhav	Sumit Kumar	Manjmath	Dattajirao B. Duxu
Designation	Trainee chemist	Executive	Team leader	Manojas est.
Signature				
Date	14/01/2026	14/01/2026	14/01/2026	14/01/2026